HAPPY SAMURAI
3 STOCKWELL STREET
GREENWICH.
LONDON
SE10 9JN

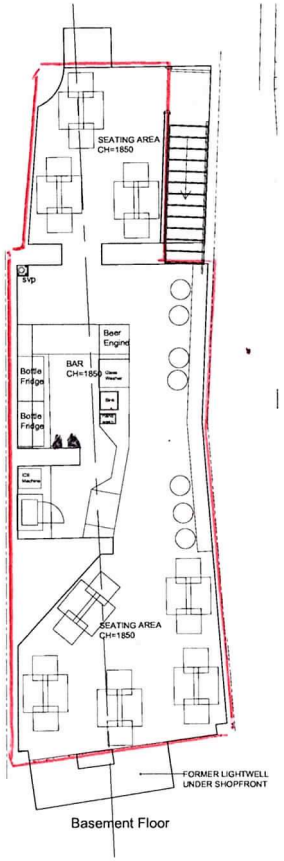

Basement Floor

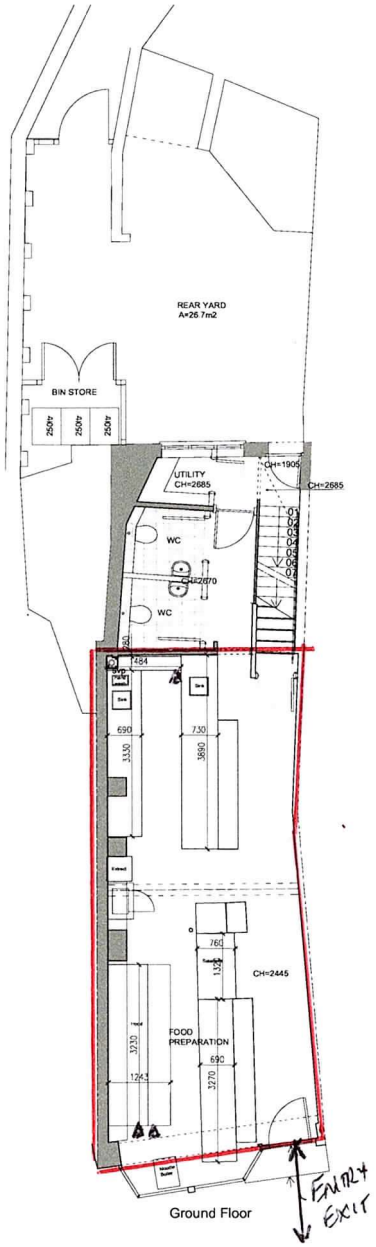

Ground Floor

Kitchen Extract

Stainless steel kitchen extract canopies, complete with removable baffle type filters, all welded and polished construction, designed and installed to DW172 specification.

Helios GBD 630 T120 3 phase fan, the fan is oversized by 30% so as to reduce noise please also note the motor is out of the airstream to prolong the unit life and for ease of cleaning. Designed and installed to DW144 specification.

2 X 500mm diameter 1200mm long attenuator pods, these will be mounted before and after the fan, designed and install to DW144 specification.

Pre and carbon filter housing, powder coated, with access to both sections, designed and installed to DW144 specification.

500mm diameter spiral ductwork for external and 500mm X 500mm square ductwork for internal, all high velocity, designed and installed to DW144 specification.

Siemens 3 phase inverter to control the Helios extract fan, mounted internally above the ceiling at second floor level, with a ip66 MK masterseal on/off switch locally installed for the operator ideally near the air conditioning controller.

All fixing and fitting to install all the above items, this will include heavy gauge unistrut 41x41mm, M10 studding, unistrut cantilever arms. Steel 50x50mm heavy duty cantilever brackets for the extract fan and anti vibration mountings where required.

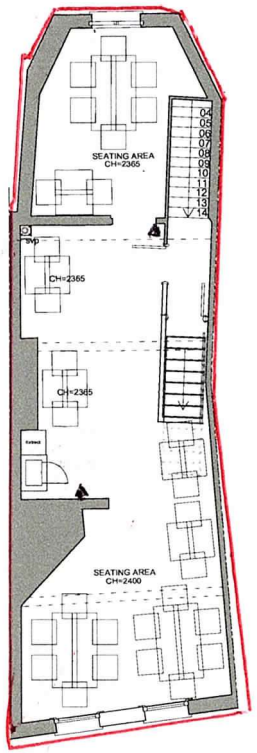

First Floor

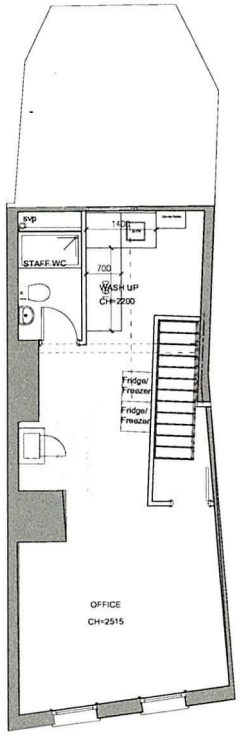

Second Floor

NOTES:

Do Not Scale.

Report all discrepancies, errors and omissions.

Verify all dimensions on site before commencing any work on site or preparing shop drawings.

All materials, components and workmanship are to comply with the relevant British Standards, Codes of Practice, and appropriate manufacturers recommendations that from time to time shall apply.

For all specialist work, see relevant drawings.

This drawing and design are copyright of Clague LLP
Registration number OC335948.

Rev	Date	Description
P1		Various amendments to layout at all floor levels including the relocation of the stair core and uses of spaces. 12th June 2020
P2		Addition of bin store to rear of property. 14 July 2020
P3		Revisions to bin store as requested by EHO and addition of kitchen extract and specification. 30 July 2020
C1		Construction issue including various layout changes to comply with site install Dec 2020

LICENSABLE AREA.

FIRE EXTINGUISHER

Project Title

3 Stockwell Street
Greenwich
London
SE10 9JN

Drawing Description

Proposed Floor Plans
Drainage Layout

Scale	Drawn by
1:50	JK2
Date	Checked by
Ferbruary 2020	KE

CLAGUE ARCHITECTS

82 Burgate, Canterbury, Kent CT1 2BH 01227 762060
1 Kingsbourne Court, Luton Road, Harpenden, Hertfordshire AL5 3BL 01582 765102
6 Darley Street, London, E9 7JP 0203 597 6112

CANTERBURY LONDON HARPENDEN

Drawing Number	Revision
/15	C1

Scale 1:50

1 2 3 5 10m

Proposed Restaurant